

M4SEDIC SERIES

IMPORTANT SAFEGUARDS

When using electrical equipment, basic safety precautions should always be followed, including the following:

THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED. DISCONNECT POWER TO ALL CIRCUITS BEFORE WIRING FIXTURE. INSTALL IN ACCORDANCE WITH ALL NATIONAL, STATE, AND LOCAL CODES. DO NOT CONNECT TO AN UNGROUNDED SUPPLY. READ ALL FIXTURE MARKINGS AND LABELS TO ENSURE CORRECT INSTALLATION OF FIXTURE. SUPPLEMENTAL INSTRUCTIONS MAY BE LOCATED ON THE FIXTURE, IN ADDITION TO THIS INSTRUCTION SHEET, REGARDING ORIENTATION, OR MOUNTING RESTRICTIONS.

SAVE THESE INSTRUCTIONS

INSTALLATION INSTRUCTIONS

Install in compliance with the National Electric Code, any applicable local codes and any specific instructions given on the luminaire labels. If installing in conjunction with any additional options and/or accessories, also refer to the respective instruction sheets. For installation only by a qualified electrician.

NOTE: To maintain the ratings and approvals noted on the fixture nameplate, any fittings or mounting hardware supplied with this fixture, must be used with this fixture. The sealed wireway (if option selected) shipped with the fixture must also be used with the wiring method selected to maintain the integrity of the fixture.

RECESSED FLANGE

NOTE: If Install Frame option (IF) is specified, see supplemental instructions provided with Install Frame.

1. Disconnect facility power to the electric supply leads.
2. To ensure an adequate seal between the flange and the ceiling system, it is important to have a square opening and a flat ceiling surface. When gypsum is used as the base material it should have adequate thickness to resist bowing. See appropriate specification sheet or contact Kenall directly for recommended ceiling cutout dimension. The cutout opening should be accurate to within a 1/16 of an inch.
3. Swing arm brackets are used to mount fixture to ceiling structure. After creating the ceiling cutout, frame the opening on the plenum side of the ceiling. See Figure 1.
4. Framing around the entire opening is recommended and should start at the rough opening. The minimum thickness of the ceiling material plus the frame material is 1-½ inches. The maximum thickness of the ceiling and framing material is 3 inches. Typically, 1-5/8 Unistrut® is used to frame the opening because of its straightness, but straight lumber can also be used (framing material by others).
5. Gypsum board shall be secured to the framing material around the opening. The ceiling surface around the opening shall be flat and smooth and not run (deviate from a straight edge) more than 1/32 inch over 2 feet. The opening should always be cut into whole pieces of gypsum. Ceiling seams and joints shall be outside of fixture cutouts. Structural members running under the gypsum shall be whole pieces around the cutouts and run the length of the cutout, not just under the swing arm bracket.
6. Fully remove door assembly from housing (including aircraft cable support) to gain access to swing-out arm screws during install. Keep inner clear protective lens installed.
7. Loosen screws from the J-box cover on top of the luminaire and open cover.
8. Connect the appropriate flexible raceway system to the wiring access hole.
9. Complete wiring. Attach Hot to black lead, neutral to white lead and ground to green lead. Connect recommended dimmer (Lutron Diva Series, DVSTV and Lutron Nova T, NTSTV-DV) to purple (+) lead and gray (-) lead. Connect leads from Kenall IC100 controller to yellow (+) lead and brown (-) lead. See additional wiring instructions if an integral emergency battery backup (LEL) system is included.
10. Close J-box cover and tighten screws.
11. Place a continuous bead of approved* caulk on the back side of the housing flange.
12. Connect the appropriate flexible raceway system to the fixture and raise the fixture into the opening.
13. Turn each of the 4 swing arm screws approximately ½ turn to swing the arm away from the housing and then lower the fixture,

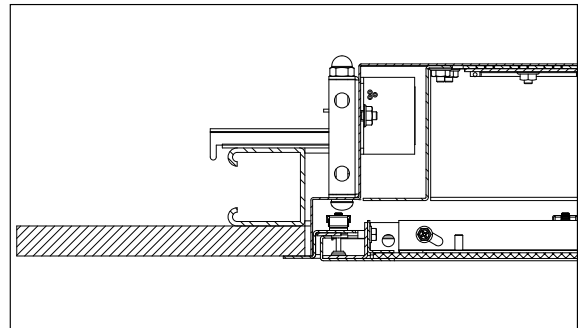


Figure 1



letting the swing arm brackets come to rest on framing.

14. Continue tightening swing arm screws until the fixture is firmly seated against the ceiling surface.
15. Suspend door assembly and reinstall aircraft cable supports . Position door frame into housing opening and start all screws by hand. Tighten all screws to seal door frame to fixture.

RECESSED GRID

1. Fixture is designed for use with 1.00"/1.50" T bar grid systems with vertical grid T thickness of less than ¼ inch with a maximum height of 1.50" inches. Grid systems can be installed with standard 12, 24 or 48 inch centerline spacing of grid.

NOTE: For all typical installations, the door assembly is to remain installed during installation procedure.

2. Fixture housing lays into grid. Verify four (4) swing arms in the stowed position as shown in Figure 2 (required to maintain fixture IP rating). If securing fixture to the superstructure with hanger wire (by others) loop wire through holes on swing arm attach bracket.
3. Loosen screws from the J-box cover on top of the luminaire and open cover.
4. Connect the appropriate flexible raceway system to the wiring access hole.
5. Complete wiring. Attach Hot to black lead, neutral to white lead and ground to green lead. Connect recommended dimmer (Lutron Diva Series, DVSTV and Lutron Nova T, NTSTV-DV) to purple (+) lead and gray (-) lead. Connect leads from Kenall IC100 controller to yellow (+) lead and brown (-) lead. See additional wiring instructions if an integral emergency battery backup (LEL) system is included.
6. Close J-box cover and tighten screws.

*GE brand RTV-108 room temperature vulcanizing silicone, or a type approved by the building owner/consulting engineer for the application.

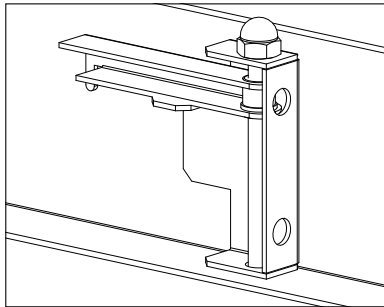


Figure 2

CUSTOMER SERVICE

For technical assistance, call 1-800-4KENALL (1-800-453-6255).

WARRANTY

This limited warranty is provided by Kenall (the Seller) to you (the Purchaser) as original purchaser of the LED lighting product. This limited warranty may be transferred to subsequent purchasers of the product as long as it is in its original packaging. Qualifying Kenall LED products shall be warranted by Kenall, for a period of five (5) years from the date of manufacture, to be free of defects in workmanship, materials, LED lamps and internal power regulation components against defects that result in an excessive lumen depreciation, as defined by L70 Luminaire Lifetime (L70) or when at least 10% of the discrete LED sources fail to illuminate. L70 shall be defined as 70% of the published warranty luminous flux at time of manufacture using IESNA LM-79-08 testing methods.

Kenall reserves the right to issue credit, repair, or replace the defective merchandise, at its discretion, upon notification and confirmation by its local representative of the defect. Kenall also reserves the right to test and examine the defective product if the defect is questionable and to deny the warranty herein for any product altered, improperly installed, installed in applications for which it is not intended. This includes operation in ambient temperatures above stated limits for any length of time. Failure by electrical surge shall not be covered under warranty.

Kenall assumes no responsibility for labor or freight costs incurred in connection with the installation, removal, or replacement of products determined to be defective or any other consequential or incidental damages arising from the use of the product. Kenall's entire liability on any claim of loss or damage resulting from a defective product is limited to the replacement price of the product.



www.kenall.com

P: 800-4-Kenall

F: 262-891-9701

10200 55th Street Kenosha, Wisconsin 53144

When you see this image, you will know the Kenall product shown or described is designed and manufactured in the USA with components purchased from US suppliers, and meets the Buy American requirements under the ARRA. Kenall has not determined the origin of its domestically purchased components or the subcomponents thereof. May be covered by patents found at www.kenall.com/patents. Content of specification sheets is subject to change; please consult www.kenall.com for current product details. © 2015 Kenall Mfg. Co. All rights reserved.

M45EDIC_F-6292_071317